
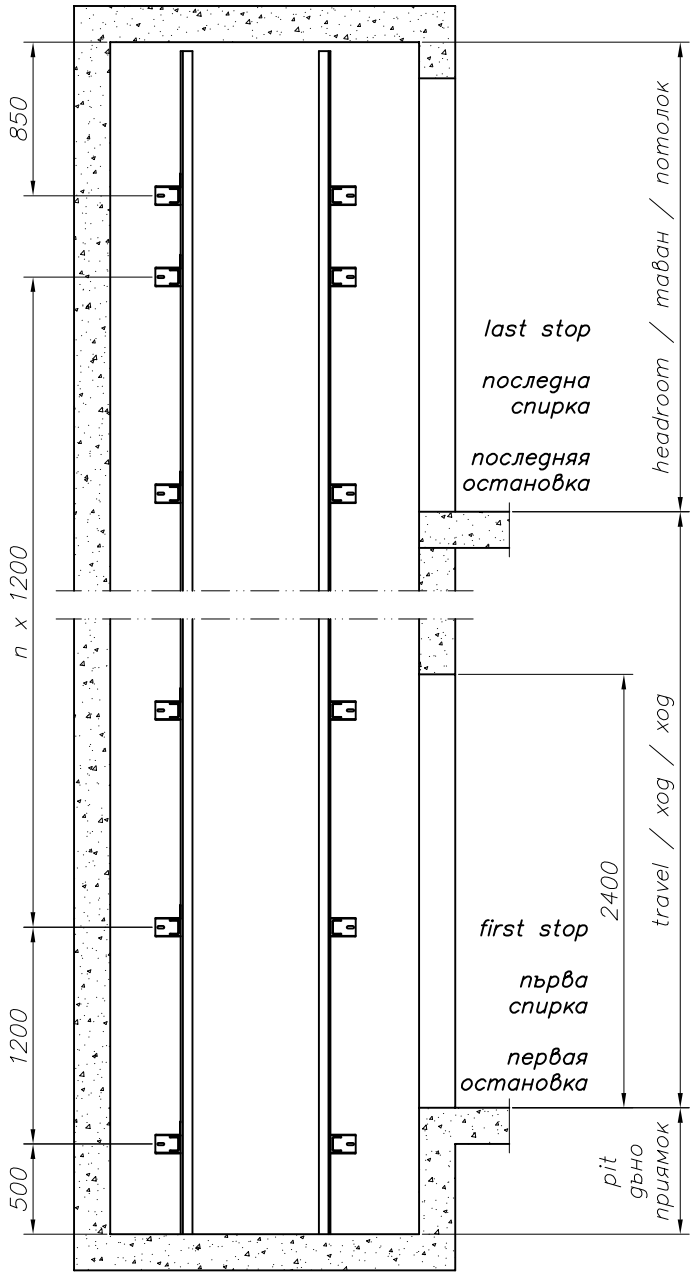


speed скорост скорость	pit дъно приямок	headroom таван потолок
0.63	200	2500

pers. лица пасс.	kg кг кг	A mm	B mm	C mm	D mm	E mm
3	250	1400	1550	850	1250	800
4	315	1450	1700	900	1400	800
5	385	1650	1700	1100	1400	900
5	400*	1450	1550	900	1250	800

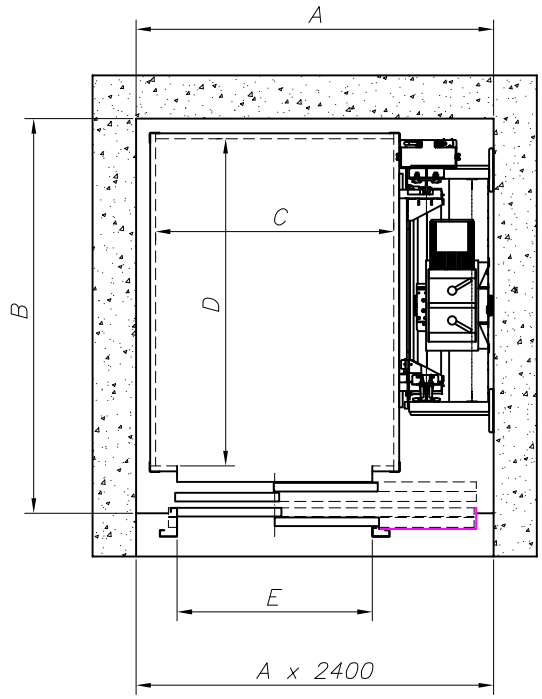

1. Deviations of the hoistway width and depth from the nominal sizes – between –20 mm +30 mm.
2. Difference between the hoistway diagonals – not more than 30 mm.
3. The deviation of the axis of the shaft in the vertical – not more than 30 mm.
4. The hoistway should not be placed over areas accessible to people.

1. Отклоненията на широчината и дълбочината на шахтата от номиналните им размери – от –20 мм до +30 мм.
2. Разликата в диагоналите на шахтата – не по–голяма от 30 мм.
3. Отклонението на оста на шахтата по вертикала – не по–голямо от 30мм.
4. Шахтата да не се разполага над пространства, достъпни за хора.

1. Отклонение ширины и глубины шахты от номинальных размеров должно быть в диапазоне от –20 мм до +30 мм.
2. Различие в диагоналях шахты должно быть не более 30 мм.
3. Отклонение оси шахты по вертикали должно быть не более 30 мм.
4. Шахта не располагается над пространством, доступным для людей.

	Лист 1/1	MRL	LP 14
L.Petrov	ИЗАМЕТ 1991		